

Proposed Amendments (added text to the code is: <u>underlined</u> , deleted text to the code is: <del>struck through</del> )				
ITEM NUMBER	ARTICLE	SUMMARY	PROPONENT	AC TION
		<b>Proposed</b>		
<b>IRC-2023-1</b>  2023 ERB Amendments submittals and Support P1	<b>M1402.1</b>	Revise section M1402 to read as follows  Section M1402 Central Furnaces M1402.1 General Oil-fired central furnaces shall conform to ANSI/UL 727. Electric furnaces shall conform to UL 1995 or UL/CSA/ANCE 60335-2-40.	Robert Glass	
<b>IRC-2023-2</b>  2023 ERB Amendments submittals and Support P3	<b>M1403.1</b>	Revise section M1403 to read as follows  Section M1403 Heat Pump Equipment M1403.1 Heat pumps Electric heat pumps shall be listed and labeled in accordance with UL 1995 or UL/CSA/ANCE 60335-2-40.	Robert Glass	
<b>IRC-2023-3</b>  2023 ERB Amendments submittals and Support P7	<b>M1412.1</b>	Revise section ‘M1412.1 Approval of equipment’ to read as follows:  Section M1412 Absorption Cooling Equipment M1412.1 Approval of equipment Absorption systems shall be installed in accordance with the manufacturer’s instructions. Absorption equipment shall comply with UL 1995 or UL/CSA/ANCE 60335-2-40.	Robert Glass	

\*Note: These amendments are “proposed only” and have not been adopted by the Department of Community Affairs.

Page 1 of 12

**ACTION: A (Approve as Submitted); R (Approve as Revised); D (Disapprove); W (Withdrawn); CF (Carry Forward)**

<p><b>IRC-2023-4</b></p> <p>2023 ERB Amendments submittals and Support P10</p>	<p>M1413.1</p>	<p>Revise section M1413.1 ‘General.’ to read as follows:</p> <p>Section M1413 Evaporative Cooling Equipment M1413.1 General Evaporative cooling equipment and appliances shall comply with UL 1995 or UL/CSA/ANCE 60335-2-40 and shall be installed:</p>	<p>Robert Glass</p>	
<p><b>IRC-2023-5</b></p> <p>2023 ERB Amendments submittals and Support P13</p>	<p>M2006.1</p>	<p>Revise section M2006.1 ‘General.’ to read as follows:</p> <p>Section M2006 Central Furnaces M2006.1 General Pool and spa heaters shall be installed in accordance with the manufacturer’s installation instructions. Oil-fired pool heaters shall comply with UL 726. Electric pool and spa heaters shall comply with UL 12161. Pool and spa heat pump water heaters shall comply with UL 1995, UL/CSA/ANCE 60335-2-40 or CSA C22.2 No. 236.</p>	<p>Robert Glass</p>	
<p><b>IRC-2023-6</b></p> <p>2023 ERB Amendments submittals and Support P16</p>	<p><u>Chapter 44</u></p>	<p>Revise Chapter 44 Reference Standards to read as follows:</p> <p><del>ANCE Association of the Electric Sector Av. Lázaro Cardenas No. 869 Col. Nueva Industrial Vallejo C.P. 07700 México D.F.</del></p> <p><del>NMX J 521/2 40- ANCE 2014/ CAN/CSA- 22.2 No. 60335 2 40 12/ UL 60335 2 40:</del></p> <p><del>Safety of Household and Similar Electric Appliances, Part 2 40: Particular Requirements for Heat Pumps, Air Conditioners and Dehumidifiers</del></p> <p><del>M1403.1, M1412.1, M1413.1</del></p>	<p>Robert Glass</p>	

\*Note: These amendments are “proposed only” and have not been adopted by the Department of Community Affairs.

**ACTION:** A (Approve as Submitted); R (Approve as Revised); D (Disapprove); W (Withdrawn); CF (Carry Forward)

		<p><b>ASHRAE</b></p> <p>ASHRAE                  1791 Tullie Circle NE Atlanta, GA 30329</p> <p>34— <del>2016</del> <u>2019</u>:</p> <p>Designation and Safety Classification of Refrigerants</p> <p>M1411.1</p> <p><b>CSA</b></p> <p>CSA Group                  8501 East Pleasant Valley Road Cleveland, OH 44131- 5516</p> <p><del>CAN/CSA/C22.2 No.</del>                  60335-2-40— <del>2012</del> <u>2019</u></p> <p>Safety of Household and Similar                  Electrical Appliances, Part 2-40: Particular Requirements for Electrical Heat Pumps, Air-                  Conditioners and Dehumidifiers</p> <p><u>M1402.1</u>, M1403.1,                  M1412.1, M1413.1, <u>M2006.1</u></p> <p><b>UL</b>                  UL LLC                  333 Pfingsten Road                  Northbrook, IL 60062</p> <p>1995— <del>2014</del> <u>2015</u></p> <p>Heating and Cooling Equipment</p>		
--	--	--	--	--

\*Note: These amendments are “proposed only” and have not been adopted by the Department of Community Affairs.

**ACTION: A (Approve as Submitted); R (Approve as Revised); D (Disapprove); W (Withdrawn); CF (Carry Forward)**

		<p>—with revisions through July 2015</p> <p>M1402.1, M1403.1,  <del>M1407.1</del>, M1412.1, M1413.1, M2006.1</p> <p>UL/CSA/ANCI 60335-2-40—  <del>2012</del>2019</p> <p>Standard for Household and Similar Electrical Appliances – <u>Safety</u> -, Part 2-40: Particular Requirements for <del>Motor compressors</del> <u>Electrical Heat Pumps, Air-Conditioners and Dehumidifiers</u></p> <p><u>M1402.1, M1403.1, M1412.1, M1413.1, M2006.1</u></p>		
IECC-2023-7	<p>2023 ERB          Amendments submittals          and Support          P21</p> <p>Opposition P23</p>	<p>Add new definition to section R202</p> <p><u>Air-Impermeable Insulation: An insulation that functions as an air barrier or an insulation combined with a atomized sealant-based system that functions as an air barrier.</u></p>	Joel Martell	
IECC-2023-8	<p>2023 ERB          Amendments submittals          and Support          P24</p>	<p>Add footnote “j” to Table 402.1.2 requiring cantilevered floors over outside air to be insulated to R-30.          Revise Table Header          Floor          R-Value</p> <p><u>i-Cantilevered floors over outside air shall be R-30 and the band area above the supporting wall shall be blocked; penetrations of blocking shall be air sealed.</u></p>	Mike Barcik, Southface, Bettie Sleeth & Tim Williams - HBAG	
IECC-2023-9		<p>Add footnote “j” to Table 402.1.4 requiring cantilevered floors over outside air to be maximum U-factor of 0.035.</p>	Mike Barcik, Southface, Bettie	

\*Note: These amendments are “proposed only” and have not been adopted by the Department of Community Affairs.

ACTION: A (Approve as Submitted); R (Approve as Revised); D (Disapprove); W (Withdrawn); CF (Carry Forward)

<p>2023 ERB Amendments submittals and Support P24</p>		<p>Revise Table Header Floor U-Factor <b>Cantilevered floors over outside air shall be U-0.035 and the band area above the supporting wall shall be blocked; penetrations of blocking shall be air sealed.</b></p>	<p>Sleeth &amp; Tim Williams - HBAG</p>	
<p>IECC-2023-10  2023 ERB Amendments submittals and Support P24</p>		<p>Add sentence to Appendix RA Georgia Insulation Installation – Passing Grade Details (p.45):  <b>Underfloor insulation</b> that makes up portions of the building thermal envelope shall be installed to Passing Grade quality. Two criteria affect installed insulation grading: <b>voids/ gaps</b> (in which no insulation is present in a portion of the overall insulated surface) and <b>compression/incomplete fill</b> (in which the insulation does not fully fill out or extend to the desired depth). <b>Cantilevered floors over outside air shall be R-30 and the band area above the supporting wall shall be blocked; penetrations of blocking shall be air sealed.</b></p>	<p>Mike Barcik, Southface, Bettie Sleeth &amp; Tim Williams - HBAG</p>	
<p>IECC-2023-11 Georgia Amendments  2023 ERB Amendments submittals and Support P26</p>		<p><b>Revise as Follows</b>  <b>R402.4.1.2 Testing.</b> All one and two-family dwelling units <b>permitted on or after January 1, 2023</b> shall be tested and verified to less than <b>4.0 air changes per hour at 50 Pascals (ACH50); all one and two-family dwelling units permitted on or after January 1, 2024 shall be tested and verified to less than 3.0.</b>  Testing shall be conducted in accordance with ASTM E 779 or ASTM E 1827 or ANSI/RESNET/ICC 380 and reported at a pressure of 0.2 inch w.g. (50 Pascals). A written report of the results of the test shall be signed by the party conducting the test and provided to the <i>code official</i>. Testing shall be performed at any time after creation of all penetrations of the <i>building thermal envelope</i>. Testing shall be conducted by a <i>certified duct and envelope tightness (DET) verifier</i>. (Remainder of section left unchanged)</p>	<p>Mike Barcik, Southface, Abe Kruger, SK Collaborative, Diana Burk, New Buildings Institute, Eric Lacey, Responsible Energy Codes Alliance</p>	
<p>IECC-2023-12 ASHRAE 90.1</p>		<p>Amend this section of 2015 IECC (similar language applies to ASHRAE 90.1-2013): <b>C402.5 Air leakage—thermal envelope (Mandatory).</b> The <i>thermal envelope</i> of buildings <b>not</b></p>	<p>Mike Barcik, Southface, Abe</p>	

\*Note: These amendments are “proposed only” and have not been adopted by the Department of Community Affairs.

**ACTION: A (Approve as Submitted); R (Approve as Revised); D (Disapprove); W (Withdrawn); CF (Carry Forward)**

<p>2023 ERB Amendments submittals and Support P28</p>		<p><b>classified as type R-2</b> shall comply with Sections C402.5.1 through C402.5.8, or the building <i>thermal envelope</i> shall be tested in accordance with ASTM E 779 at a pressure differential of 0.3 inch water gauge (75 Pa) or an equivalent method approved by the code official and deemed to comply with the provisions of this section when the tested air leakage rate of the building thermal envelope is not greater than 0.40 cfm/ft<sup>2</sup> (0.2 L/s · m<sup>2</sup>). Where compliance is based on such testing, the building shall also comply with Sections C402.5.5, C402.5.6 and C402.5.7.</p>	<p>Kruger, SK Collaborative, Diana Burk, New Buildings Institute, Eric Lacey, Responsible Energy Codes Alliance</p>	
<p><b>IECC-2023-13</b> ASHRAE 90.1  2023 ERB Amendments submittals and Support P28</p>		<p>Add new section of 2015 IECC (similar also applies to ASHRAE 90.1-2013): <b>C402.5 Air leakage—thermal envelope for Mid-rise multifamily (Mandatory).</b> The <i>thermal envelope</i> of buildings shall comply with Sections C402.5-MF and C402.5.1-MF  <b>C402.5-MF multifamily dwelling testing (Mandatory).</b> All commercial type R-2 multifamily dwellings (regardless of number of stories of dwelling units) shall be tested to less than 5.0 air changes per hour at 50 Pascals (ACH50). As an alternative to ACH50, compliance for commercial type R-2 dwellings may be attained by achieving an Envelope Leakage Ratio at 50 Pascals (ELR50) of less than 0.30 (ELR50 &lt; 0.30, where ELR50 = CFM50 / Envelope Shell Area, in square feet).</p>	<p>Mike Barcik, Southface, Abe Kruger, SK Collaborative, Diana Burk, New Buildings Institute, Eric Lacey, Responsible Energy Codes Alliance</p>	
<p><b>IECC-2023-14</b> ASHRAE 90.1  2023 ERB Amendments submittals and Support P28</p>		<p>*Add a new Section C402.5.1MF ‘Low-rise multifamily testing protocol (Optional)’ to read as follows: <b>C402.5.1-MF multifamily testing protocol (Optional).</b> Commercial type R-2 multifamily dwellings (regardless of number of stories of dwelling units) may (optionally) employ either one or both of the following testing protocols: 1. Utilize multiple fans in adjacent units (commonly referred to as Guarded Blower Door testing) to minimize effect of leakage to adjacent units (not required). 2. Envelope testing of less than 100 percent shall be acceptable assuming a maximum sampling protocol of 1 in 4 dwelling units per floor (if sampled unit passes, the remaining up to three units are deemed to comply; if sampled unit fails, it must be sealed and retested and the remaining up to three units shall also be tested).</p>	<p>Mike Barcik, Southface, Abe Kruger, SK Collaborative, Diana Burk, New Buildings Institute, Eric Lacey, Responsible Energy Codes Alliance</p>	
<p><b>IECC-2023-15</b> <b>Georgia Amendments</b></p>		<p>Amend this section of ASHRAE 90.1-2013 (same requirement as IECC 2015): C401.2 Application</p>	<p>Mike Barcik, Southface, Abe</p>	

\*Note: These amendments are “proposed only” and have not been adopted by the Department of Community Affairs.

**ACTION:** A (Approve as Submitted); R (Approve as Revised); D (Disapprove); W (Withdrawn); CF (Carry Forward)

2023 ERB Amendments submittals and Support P28		Commercial buildings shall comply with one of the following: 1. The requirements of ANSI/ASHRAE/IESNA 90.1 <b>and Section C402.5 (air leakage testing for mid-rise multifamily dwellings)</b>	Kruger, SK Collaborative, Diana Burk, New Buildings Institute, Eric Lacey, Responsible Energy Codes Alliance	
IECC-2023-16 Georgia Amendments  2023 ERB Amendments submittals and Support P31		<b>R402.4.1.3 Low-rise R-2 multifamily testing (Mandatory)</b> . Low-rise R-2 multifamily dwellings shall be tested to less than <b>5.0</b> air changes per hour at 50 Pascals (ACH50). As an alternative to ACH50, compliance for Low-rise R-2 dwellings may be attained by achieving an Envelope Leakage Ratio at 50 Pascals (ELR50) of less than <b>0.30</b> (ELR50 < 0.30, where ELR50 = CFM50 / Envelope Shell Area, in square feet).	Mike Barcik, Southface, Abe Kruger, SK Collaborative, Diana Burk, New Buildings Institute, Eric Lacey, Responsible Energy Codes Alliance	
IECC-2023-17 Georgia Amendments  2023 ERB Amendments submittals and Support P31		<b>R402.4.1.3.1 Low-rise multifamily testing protocol (Optional)</b> . Where a residential building is classified as R-2, envelope testing may (optionally) employ either one or both of the following testing protocols: 1. Utilize multiple fans in adjacent units (commonly referred to as Guarded Blower Door testing) to minimize effect of leakage to adjacent units (not required). 2. Envelope testing of less than 100 percent shall be acceptable assuming a maximum sampling protocol of 1 in 4 units per floor (if sampled unit passes, the remaining up to three units are deemed to comply; if sampled unit fails, it must be sealed and retested and the remaining up to three units shall also be tested).	Mike Barcik, Southface, Abe Kruger, SK Collaborative, Diana Burk, New Buildings Institute, Eric Lacey, Responsible Energy Codes Alliance	
IECC-2023-18 ASHRAE 90.1  2023 ERB Amendments submittals and Support P34		Amend section C402.5 of 2015 IECC (similar applies to ASHRAE 90.1-2013): <b>C402.5 Air leakage—thermal envelope (Mandatory)</b> . The <i>thermal envelope</i> of buildings <b>25,000 s.f. and greater</b> shall comply with Sections C402.5.1 through C402.5.8, or the building <i>thermal envelope</i> shall be tested in accordance with ASTM E 779 at a pressure differential of 0.3 inch water gauge (75 Pa) or an equivalent method approved by the code official and deemed to comply with the provisions of this section when the tested air leakage rate of the building thermal envelope is not greater than 0.40 cfm/ft <sup>2</sup> (0.2 L/s · m <sup>2</sup> ). Where compliance is based on such testing, the building shall also comply with Sections C402.5.5, C402.5.6 and C402.5.7.	Mike Barcik, Southface, Abe Kruger, SK Collaborative, Diana Burk, New Buildings Institute, Eric Lacey, Responsible Energy Codes Alliance	
IECC-2023-19 ASHRAE 90.1		Add new section of 2015 IECC (similar applies to ASHRAE 90.1-2013): <b>C402.5-LC Air leakage—thermal envelope for Light Commercial buildings under 25,000 sf.</b>	Mike Barcik, Southface, Abe	

\*Note: These amendments are “proposed only” and have not been adopted by the Department of Community Affairs.

**ACTION:** A (Approve as Submitted); R (Approve as Revised); D (Disapprove); W (Withdrawn); CF (Carry Forward)

<p>2023 ERB Amendments submittals and Support P34</p>		<p><b>(Mandatory).</b> The <i>thermal envelope</i> of buildings under 25,000 s.f. not classified as type R-2 shall be tested in accordance with ASTM E 779 at a pressure differential of 0.3 inch water gauge (75 Pa) or an equivalent method approved by the code official and deemed to comply with the provisions of this section when the tested air leakage rate of the building thermal envelope is not greater than 0.40 cfm/ft<sup>2</sup> (0.2 L/s · m<sup>2</sup>). Where compliance is based on such testing, the building shall also comply with Sections C402.5.5, C402.5.6 and C402.5.7.</p>	<p>Kruger, SK Collaborative, Diana Burk, New Buildings Institute, Eric Lacey, Responsible Energy Codes Alliance</p>	
<p><b>IECC-2023-20</b> ASHRAE 90.1  2023 ERB Amendments submittals and Support P34</p>		<p>Amend this section to ASHRAE 90.1-2013 (same requirements for projects using 90.1): C401.2 Application Commercial buildings shall comply with one of the following: 1. The requirements of ANSI/ASHRAE/IESNA 90.1 and Section C402.5-LC (air leakage testing for Light Commercial buildings under 25,000 s.f.)</p>	<p>Mike Barcik, Southface, Abe Kruger, SK Collaborative, Diana Burk, New Buildings Institute, Eric Lacey, Responsible Energy Codes Alliance</p>	
<p><b>IRC-2023-21</b>  2023 ERB Amendments submittals and Support P37 and end of chart</p>		<p>Add section 806 option a *see attached sheet.</p>	<p>Shawn Mullins</p>	
<p><b>IRC-2023-22</b>  2023 ERB Amendments submittals and Support P42 and end of chart</p>		<p>Add section 806 option b *see attached sheet. -either/or of the previous amendment</p>	<p>Shawn Mullins</p>	
<p><b>IBC-2023-23</b>  2023 ERB Amendments submittals and Support</p>		<p>Revise Exception 2  1511.1 General.  Materials and methods of application for recovering or replacing an existing roof covering shall</p>	<p>Christian N. Dawkins, P.E.</p>	

\*Note: These amendments are “proposed only” and have not been adopted by the Department of Community Affairs.

**ACTION:** A (Approve as Submitted); R (Approve as Revised); D (Disapprove); W (Withdrawn); CF (Carry Forward)



P47		<p>comply with the requirements of Chapter 15.</p> <p>1. Roof replacement or roof recover of existing low-slope roof coverings shall not be required to meet the minimum design slope requirement of one-quarter unit vertical in 12 units horizontal (2-percent slope) in Section 1507 for roofs that provide positive roof drainage.</p> <p>2. Recovering or replacing an existing roof covering shall not be required to meet the requirement for secondary (emergency overflow) drains or scuppers in Section 1502.2 for roofs that provide for positive roof drainage, <u>and have been determined to resist all design loads</u>. For the purposes of this exception, existing secondary drainage or scupper systems required in accordance with this code shall not be removed unless they are replaced by secondary drains or scuppers designed and installed in accordance with Section 1502.2.</p>		
<p>IBC-2023-24</p> <p>2023 ERB                  Amendments submittals                  and Support                  P49</p>		<p>Revise Exception 1</p> <p><b>1511.1 General.</b>                  Materials and methods of application for recovering or replacing an existing <i>roof covering</i> shall comply with the requirements of Chapter 15.</p> <p><b>Exceptions:</b></p> <p>1. <i>Roof replacement</i> or <i>roof recover</i> of existing low-slope <i>roof coverings</i> shall not be required to meet the minimum design slope requirement of one-quarter unit vertical in 12 units horizontal (2-percent slope) in Section 1507 for roofs that provide <i>positive roof drainage</i> <u>and meet the requirements of Section 1608.3 and Section 1611.2.</u></p> <p>2. Recovering or replacing an existing <i>roof covering</i> shall not be required to meet the requirement for secondary (emergency overflow) drains or scuppers in Section 1502.2 for roofs that provide for <i>positive roof drainage</i>. For the purposes of this exception, existing secondary drainage or <i>scupper systems</i> required in accordance with this code shall not be removed unless they are replaced by secondary drains or <i>scuppers</i> designed and installed in accordance with Section 1502.2.</p>	Christian N. Dawkins, P.E.	

\*Note: These amendments are “proposed only” and have not been adopted by the Department of Community Affairs.

ACTION: A (Approve as Submitted); R (Approve as Revised); D (Disapprove); W (Withdrawn); CF (Carry Forward)

<p><b>IBC-2023-25</b></p> <p>2023 ERB Amendments submittals and Support P58</p>		<p>Add New Section</p> <p><b>1502.5 Waterproofing weather-exposed areas.</b> Balconies, decks, landings, exterior stairways, occupied roofs, and similar surfaces exposed to the weather and sealed underneath shall be waterproofed and sloped a minimum of 1/4 unit vertical in 12 units horizontal (2% slope) for drainage away from adjoining walls or assemblies.</p>	<p>Christian N. Dawkins, P.E.</p>	
<p><b>IBC-2023-26</b></p> <p>2023 ERB Amendments submittals and Support P59</p>		<p><b>Revise as Follows</b> <b>1511.3.1.1 Exceptions.</b> A <i>roof recover</i> shall not be permitted where any of the following conditions occur: 1. Where the existing roof or roof covering is <del>water soaked</del> <u>found to have moisture present from Infrared testing (per ASTM C1153–10 (Reapproved 2015)), Electrical Impedance testing (per ASTM D7954/ D7954M –15a) or Nuclear testing (per ANSI/SPRI/RCI NT-1 2012 (Reapproved 2017))</u> to the extent the existing roof or roof covering cannot be removed and restored on a spot basis, or where the existing roof or roof covering has deteriorated to the point <del>that the existing roof or roof covering it</del> is not adequate as a base for additional roofing. 2. Where the existing roof covering is slate, clay, cement or asbestos-cement tile. 3. Where the existing roof has two or more applications of any type of roof covering</p>	<p>Christian N. Dawkins, P.E.</p>	
<p><b>IRC-2023-27</b></p> <p>2023 ERB Amendments submittals and Support P61</p>		<p><b>Add new section</b></p> <p><b>R903.5 Waterproofing weather-exposed areas.</b> Balconies, decks, landings, exterior stairways, occupied roofs, and similar surfaces exposed to the weather and sealed underneath shall be waterproofed and sloped a minimum of 1/4 unit vertical in 12 units horizontal (2% slope) for drainage away from</p>	<p>Christian N. Dawkins, P.E.</p>	

\*Note: These amendments are “proposed only” and have not been adopted by the Department of Community Affairs.

**ACTION:** A (Approve as Submitted); R (Approve as Revised); D (Disapprove); W (Withdrawn); CF (Carry Forward)

		adjoining walls or assemblies.		
<b>IRC-2023-28</b>  2023 ERB Amendments submittals and Support P62		Revise as Follows R703.7.3  <i>Water-resistive barriers</i> shall be installed as required in Section 703.2 and, where applied over <del>wood-based</del> sheathing, shall include a water-resistive, vapor-permeable barrier with a performance at least equivalent to two layers of Grade D paper. The individual layers shall be installed independently such that each layer provides a separate continuous plane and any flashing, installed in accordance with Section R703.4 and intended to drain to the water-resistive barrier shall be directed <del>between the layers</del> <u>over the top of the water-resistive barrier.</u>	Christian N. Dawkins, P.E.	
<b>IRC – 2023 – 29 Ga Amendments</b>  2023 ERB Amendments submittals and Support P63		Revise Georgia International Residential Code 2020 Amendments as follows:  <b>SECTION R303 LIGHT, VENTILATION AND HEATING</b> <i>*Revise Section R303.4 ‘Mechanical ventilation’ to read as follows:</i> <b>R303.4 Mechanical ventilation.</b> Where the air infiltration rate of a <i>dwelling unit</i> is 3 air changes per hour or less where tested with a blower door at a pressure of 0.2 inch w.e (50 Pa) in accordance with Section N1102.4.1.2, the <i>dwelling unit</i> shall be provided with whole-house mechanical ventilation in accordance with Section M1505.4. (Effective January 1, 2020)	Eric Lacey	

\*Note: These amendments are “proposed only” and have not been adopted by the Department of Community Affairs.


DRAFT

\*Note: These amendments are “proposed only” and have not been adopted by the Department of Community Affairs.

**ACTION: A (Approve as Submitted); R (Approve as Revised); D (Disapprove); W (Withdrawn); CF (Carry Forward)**

# GEORGIA DEPARTMENT OF COMMUNITY AFFAIRS

## CODE AMENDMENT FORM

ITEM NO: \_\_\_\_\_ (DCA USE ONLY) PAGE 1 OF 5

CODE: IRC SECTION: 806

Shawn Mullins on behalf of Owens

PROPOSER: Corning DATE: 12/13/21

EMAIL: shawn.mullins@owenscorning.com

ADDRESS: 9538 W Patrick Lane, Peoria, AZ 85383

TELEPHONE NUMBER: (623)695-5694 FAX NUMBER: (480)500-6158

CHECK  Revise section to read as follows:  Add new section to read as follows:

ONE:  Delete section and substitute the following:  Delete without substitution:

~~LINE THROUGH MATERIAL TO BE DELETED:~~ UNDERLINE MATERIAL TO BE ADDED

Approve  Approve as amended (DCA STAFF ONLY)  Disapprove  Withdrawn

### DESCRIPTION:

See text below and NOTE – this proposal submitted via email to Jim Reynolds: jim.reynolds@dca.ga.gov

### REASON/INTENT:

See reason statement below

### FINANCIAL IMPACT OF PROPOSED AMENDMENT:

None

# **PROPOSED SUPPLEMENTAL LANGUAGE TO THE 2018 GEORGIA INTERNATIONAL RESIDENTIAL CODE BUILDING CODE**

## **CHAPTER 8 ROOF-CEILING CONSTRUCTION**

### **SECTION R806**

#### **ROOF VENTILATION**

##### **R806.1 Ventilation required.**

Enclosed attics and enclosed rafter spaces formed where ceilings are applied directly to the underside of roof rafters shall

have cross ventilation for each separate space by ventilating openings protected against the entrance of rain or snow.

Ventilation openings shall have a least dimension of  $\frac{1}{4}$  inch (1.6 mm) minimum and  $\frac{1}{2}$  inch (6.4 mm) maximum.

Ventilation openings having a least dimension larger than  $\frac{1}{2}$  inch (6.4 mm) shall be provided with corrosion-resistant

wire cloth screening, hardware cloth, perforated vinyl or similar material with openings having a least dimension of  $\frac{1}{4}$

inch (1.6 mm) minimum and  $\frac{1}{2}$  inch (6.4 mm) maximum. Openings in roof framing members shall conform to the

requirements of Section R802.7. Required ventilation openings shall open directly to the outside air and shall be

protected to prevent the entry of birds, rodents, snakes and other similar creatures.

##### **R806.2 Minimum vent area.**

The minimum net free ventilating area shall be  $\frac{1}{30}$  of the area of the vented space.

Exception: The minimum net free ventilation area shall be  $\frac{1}{30}$  of the vented space provided both of the following

conditions are met:

1. In Climate Zones 6, 7 and 8, a Class I or II vapor retarder is installed on the warm-in-winter side of the ceiling.

2. Not less than 40 percent and not more than 50 percent of the required ventilating area is provided by ventilators located in the upper portion of the attic or rafter space. Upper ventilators shall be located not more than 3 feet (914 mm) below the ridge or highest point of the space, measured vertically. The balance of the required ventilation provided shall be located in the bottom one-third of the attic space. Where the location of

wall or roof framing members conflicts with the installation of upper ventilators, installation more than 3 feet (914 mm) below the ridge or highest point of the space shall be permitted.

##### **R806.3 Vent and insulation clearance.**

Where eave or cornice vents are installed, blocking, bridging and insulation shall not block the free flow of air. Not less

than a 1-inch (25 mm) space shall be provided between the insulation and the roof sheathing and at the location of the

vent.

##### **R806.4 Installation and weather protection.**

Ventilators shall be installed in accordance with manufacturer's instructions. Installation of ventilators in roof systems

shall be in accordance with the requirements of Section R903. Installation of ventilators in wall systems shall be in

accordance with the requirements of Section R703.1.

##### **R806.5 Unvented attic and unvented enclosed rafter assemblies**

5. 2 In Climate Zones 1,2 and 3, air-permeable insulation installed in unvented attics shall meet the following requirements.

5.2.1 An approved vapor diffusion port shall be installed not more than 12 inches (305 mm) from the highest point of the roof, measured vertically from the highest point of the roof to the lower edge of the port.

5.2.2. The port area shall be greater than or equal to 1:150 of the ceiling area. Where there are multiple ports in the attic, the sum of the port areas shall be greater than or equal to the area requirements.

5.2.3 The vapor-permeable membrane in the vapor diffusion port shall have a vapor permeance rating of great than or equal to 20 perms when tested in accordance with Procedure A of ASTM E96.

5.2.4 The vapor diffusion port shall serve as an air barrier between the attic and the exterior of the building.

5.2.5. The vapor diffusion port shall protect the attic against the entrance of rain or snow.

5.2.6 Framing members and blocking shall not block the free flow of water vapor to the port. Not less than a 2-inch (51 mm) space shall be provided between any blocking and the roof sheathing. Air-permeable insulation shall be permitted within that space.

5.2.7 The roof slope shall be greater than or equal to 3:12 (vertical/horizontal)

5.2.8 Where only air-permeable insulation is used, it shall be installed directly below the structural roof sheathing.

5.2.9 Air-impermeable insulation, if any, shall be directly above or below the structural roof sheathing and is not required to meet the R-value in Table 806.5. Where directly below the structural roof sheathing, there shall be no space between the air-impermeable insulation and air-permeable insulation.

5.2.10 The air shall be supplied to a flow rate greater than or equal to 50 CFM (23.6 L/s) per 1,000 square feet (93 m<sup>2</sup>) of ceiling. The air shall be supplied from ductwork providing supply air to the occupiable space when the conditioning system is operating. Alternatively, the air shall be supplied by a supply fan when the conditioning system is operating.

### **Reason Statement:**

The 2018 IRC introduced unvented attics and unvented enclosed rafter assemblies using only air permeable insulation as an acceptable construction method as long as certain criteria and guidelines are followed. One of the key guidelines in using air permeable insulation in an unvented attic is the addition of a vapor diffusion port, this port constructability is similar to the addition of a ridge vent in traditional roof assemblies. This system has been studied, researched and vetted for many years and has been proven to be successful.

Advantages:

- **Airtightness.** a house that has a conditioned unvented attic can be significantly more airtight than houses without it thus making it more energy efficient. Even though the model code has requirements for duct tightness levels the ductwork and air handlers are often leaky. Often the ductwork and/or the air handlers are located in the attic, if the attic is conditioned the leaks will not have a big energy penalty, if the attic is unconditioned and vented the leaks from these systems can result in a pressure difference causing more infiltration into the home. Figure 1, below outlines this issue.

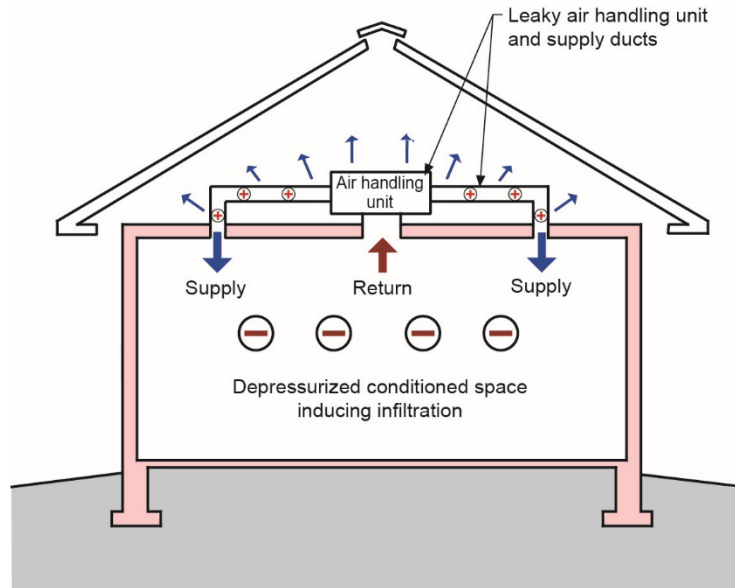


Figure 1. (Lstiburek, J.W.)

- Fire Protection.** Unvented attics can provide other benefits as well including helping to reduce the spread of fires. This is particularly true for areas where buildings are close to one another, typically fires start in neighboring buildings due to debris getting sucked into the house via attics vents, if there are no vents it can significantly reduce the fire risk.
- Wind Uplift.** Other benefits come in areas of the country where there is a high wind potential, mostly the coastal areas. High wind events can cause the soffit vents to breakdown and create significant uplift on the roof assemblies which can cause damage to the roof assembly and rest of the dwelling.
- Moisture Control in Humid Climates.** The traditional way of thinking is that vented attics help to alleviate moisture issues and this may be true in certain climate zones. In a hot humid climate having a vented attic will cause moisture problems, it will bring the hot humid air from outside the home into the attic which causes ductwork to sweat which in turn can cause moisture and mold growth on sheathing and framing. The alternative is unvented attics, these attics have shown to have some moisture concerns as well near the ridge, however, the introduction of vapor diffusion ports has shown to significantly reduce the moisture build up in these area to help to alleviate moisture build up. The difference in moisture is shown below.

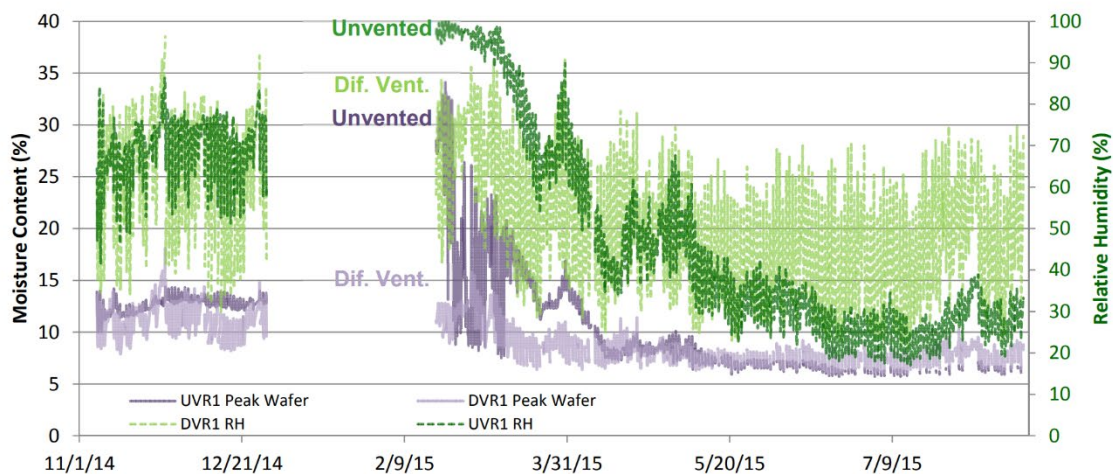


Figure 2. (Ueno, K and Lstiburek, J.W)

- Cost Effectiveness.** *Description on how using air-permeable insulation to construct a home with a conditioned attic is a low cost pathway for builders*



References:

1. Lstiburek, J.W.; Venting vapor, ASHRAE Journal, July 2015.
2. Ueno, K and Lstiburek, J.W.; Building America Report: Field testing of an unvented roof with fibrous insulation, tiles, and vapor diffusion venting, Building Science Corporation, November 2015.

Regards,

**Shawn Mullins**

Sr. Sales Lead: Technical Sales & Government  
Affairs

North American Building Insulation | Sales

M: 623-695-5694

[shawn.mullins@owenscorning.com](mailto:shawn.mullins@owenscorning.com)

# GEORGIA DEPARTMENT OF COMMUNITY AFFAIRS

## CODE AMENDMENT FORM

ITEM NO: \_\_\_\_\_ (DCA USE ONLY) PAGE 1 OF 5

CODE: IRC SECTION: 806

Shawn Mullins on behalf of Owens

PROPONENT: Corning DATE: 12/13/21

EMAIL: shawn.mullins@owenscorning.com

ADDRESS: 9538 W Patrick Lane, Peoria, AZ 85383

TELEPHONE NUMBER: (623)695-5694 FAX NUMBER: (480)500-6158

CHECK  Revise section to read as follows:  Add new section to read as follows:

ONE:  Delete section and substitute the following:  Delete without substitution:

~~LINE THROUGH MATERIAL TO BE DELETED:~~ UNDERLINE MATERIAL TO BE ADDED

Approve  Approve as amended (DCA STAFF ONLY)  Disapprove  Withdrawn

### DESCRIPTION:

See text below and NOTE – this proposal submitted via email to Jim Reynolds: jim.reynolds@dca.ga.gov

### REASON/INTENT:

See reason statement below

### FINANCIAL IMPACT OF PROPOSED AMENDMENT:

None

# **PROPOSED SUPPLEMENTAL LANGUAGE TO THE 2018 GEORGIA INTERNATIONAL RESIDENTIAL CODE BUILDING CODE**

## **CHAPTER 8 ROOF-CEILING CONSTRUCTION**

### **SECTION R806**

#### **ROOF VENTILATION**

##### **R806.1 Ventilation required.**

Enclosed attics and enclosed rafter spaces formed where ceilings are applied directly to the underside of roof rafters shall

have cross ventilation for each separate space by ventilating openings protected against the entrance of rain or snow.

Ventilation openings shall have a least dimension of  $\frac{1}{4}$  inch (1.6 mm) minimum and  $\frac{1}{2}$  inch (6.4 mm) maximum.

Ventilation openings having a least dimension larger than  $\frac{1}{2}$  inch (6.4 mm) shall be provided with corrosion-resistant

wire cloth screening, hardware cloth, perforated vinyl or similar material with openings having a least dimension of  $\frac{1}{4}$

inch (1.6 mm) minimum and  $\frac{1}{2}$  inch (6.4 mm) maximum. Openings in roof framing members shall conform to the

requirements of Section R802.7. Required ventilation openings shall open directly to the outside air and shall be

protected to prevent the entry of birds, rodents, snakes and other similar creatures.

##### **R806.2 Minimum vent area.**

The minimum net free ventilating area shall be  $\frac{1}{30}$  of the area of the vented space.

Exception: The minimum net free ventilation area shall be  $\frac{1}{30}$  of the vented space provided both of the following

conditions are met:

1. In Climate Zones 6, 7 and 8, a Class I or II vapor retarder is installed on the warm-in-winter side of the ceiling.

2. Not less than 40 percent and not more than 50 percent of the required ventilating area is provided by ventilators located in the upper portion of the attic or rafter space. Upper ventilators shall be located not more than 3 feet (914 mm) below the ridge or highest point of the space, measured vertically. The balance of the required ventilation provided shall be located in the bottom one-third of the attic space. Where the location of

wall or roof framing members conflicts with the installation of upper ventilators, installation more than 3 feet (914 mm) below the ridge or highest point of the space shall be permitted.

##### **R806.3 Vent and insulation clearance.**

Where eave or cornice vents are installed, blocking, bridging and insulation shall not block the free flow of air. Not less

than a 1-inch (25 mm) space shall be provided between the insulation and the roof sheathing and at the location of the

vent.

##### **R806.4 Installation and weather protection.**

Ventilators shall be installed in accordance with manufacturer's instructions. Installation of ventilators in roof systems

shall be in accordance with the requirements of Section R903. Installation of ventilators in wall systems shall be in

accordance with the requirements of Section R703.1.

##### **R806.5 Unvented attic, sealed attic and unvented enclosed rafter assemblies**

R806.5 Unvented attics with insulation and thermal boundary located at the roof deck

1. The unvented attic space is completely within the building thermal envelope.
2. Interior Class I vapor retarders are not installed on the ceiling side (attic floor) of the unvented attic assembly.
3. Where wood shingles or shakes are used, a minimum 1/2-inch (6.4 mm) vented airspace separates the shingles or shakes and the roofing underlayment above the structural sheathing.
4. Air-impermeable insulation
  - 4.1. In Climate Zones 5, 6, 7 and 8, any air-impermeable insulation shall be a Class II vapor retarder or, shall have a Class II vapor retarder coating or covering in direct contact with the underside of the insulation.
  - 4.2. The air-impermeable insulation shall be applied in direct contact with the underside of the structural roof sheathing and shall be in accordance with the R-values in Table R806.5 for condensation control
  - 4.3. Alternatively, sufficient rigid board or sheet insulation shall be installed directly above the structural roof sheathing to maintain the monthly average temperature of the underside of the structural roof sheathing above 45°F (7°C). For calculation purposes, an interior air temperature of 68°F (20°C) is assumed and the exterior air temperature is assumed to be the monthly average outside air temperature of the three coldest months.
5. Air-permeable Insulation
  - 5.1 Air-impermeable insulation shall be applied in direct contact with the underside of the structural roof sheathing, except that it shall also be in accordance with the R-values in Table R806.5 for condensation control, and thus include a layer of air-impermeable insulation where required by Table R806.5..
  - 5.2 Positively pressured air shall be supplied to the attic space at a flow rate greater than or equal to 50 CFM (23.6 L/s) per 1,000 square feet (93 m<sup>2</sup>) of ceiling. The air shall be supplied from ductwork providing supply air to the occupiable space when the conditioning system is operating. Alternatively, the air shall be supplied by a supply fan when the conditioning system is operating
6. Combination of air-impermeable and air-permeable insulation
  - 6.1. Where both air-impermeable and air-permeable insulation are provided, the air-impermeable insulation shall be applied in direct contact with the underside of the structural roof sheathing and shall be in accordance with the R-values in Table R806.5 for condensation control. The air-permeable insulation shall be installed directly under the air-impermeable insulation.
  - 6.2. Where preformed insulation board is used as the air-impermeable insulation layer, it shall be sealed at the perimeter of each individual sheet interior surface to form a continuous layer
  - 6.3. Positively pressured air shall be supplied to the attic space at a flow rate greater than or equal to 50 CFM (23.6 L/s) per 1,000 square feet (93 m<sup>2</sup>) of ceiling. The air shall be supplied from ductwork providing supply air to the occupiable space when the conditioning system is operating. Alternatively, the air shall be supplied by a supply fan when the conditioning system is operating

R806.6 Sealed attic with diffusion ports with air-permeable insulation and thermal boundary located at the ceiling

1. The unvented attic space is completely within the building thermal envelope.
2. In Climate Zones 1, 2 and 3, air-permeable insulation installed in sealed attics shall meet the following requirements:
  - 2.1 An approved vapor diffusion port shall be installed not more than 12 inches (305 mm) from the highest point of the roof, measured vertically from the highest point of the roof to the lower edge of the port.
  - 2.2 The port area shall be greater than or equal to 1:150 of the ceiling area. Where there are multiple ports in the attic, the sum of the port areas shall be greater than or equal to the area requirement.
  - 2.3 The vapor-permeable membrane in the vapor diffusion port shall have a vapor permeance rating of greater than or equal to 20 perms when tested in accordance with Procedure A of ASTM E96.
  - 2.4 The vapor diffusion port shall serve as an air barrier between the attic and the exterior of the building.
  - 2.5 The vapor diffusion port shall protect the attic against the entrance of rain and snow.
  - 2.6 Framing members and blocking shall not block the free flow of water vapor to the port. Not less than a 2-inch (51 mm) space shall be provided between any blocking and the roof sheathing. Air-permeable insulation shall be permitted within that space.

## 2.7 Positively pressured air to the attic space is not required in this assembly.

### R806.7 Enclosed Rafter Spaces

Enclosed roof framing assemblies created by ceilings that are applied directly to the underside of the roof framing members and structural roof sheathing applied directly to the top of the roof framing members/rafters, shall adhere to the following:

1. Interior Class I vapor retarders are not installed on the ceiling side of the unvented enclosed roof framing assembly.
2. Where wood shingles or shakes are used, a minimum 1/2-inch (6.4 mm) vented airspace separates the shingles or shakes and the roofing underlayment above the structural sheathing
3. Enclosed rafter spaces shall comply with Sections R806.1, R806.2 and R806.3 of this Code.

### **Reason Statement:**

The 2018 IRC introduced unvented attics and unvented enclosed rafter assemblies using only air permeable insulation as an acceptable construction method as long as certain criteria and guidelines are followed. One of the key guidelines in using air permeable insulation in an unvented attic is the addition of a vapor diffusion port, this port constructability is similar to the addition of a ridge vent in traditional roof assemblies. This system has been studied, researched and vetted for many years and has been proven to be successful. This language carries over existing IRC language and further breaks it into more manageable and understandable sections, based on assembly type(s) and thermal boundary location. The expectation is that by doing so the intent of this code can be more easily understood and executed. Additionally, the intention here is to reformat existing base IRC model code language into more manageable and understandable sections, based on assembly type(s) and thermal boundary location. The expectation is that by doing so the intent of this code can be more easily understood and executed.

Advantages:

- **Airtightness.** a house that has a conditioned unvented attic can be significantly more airtight than houses without it thus making it more energy efficient. Even though the model code has requirements for duct tightness levels the ductwork and air handlers are often leaky. Often the ductwork and/or the air handlers are located in the attic, if the attic is conditioned the leaks will not have a big energy penalty, if the attic is unconditioned and vented the leaks from these systems can result in a pressure difference causing more infiltration into the home. Figure 1, below outlines this issue.

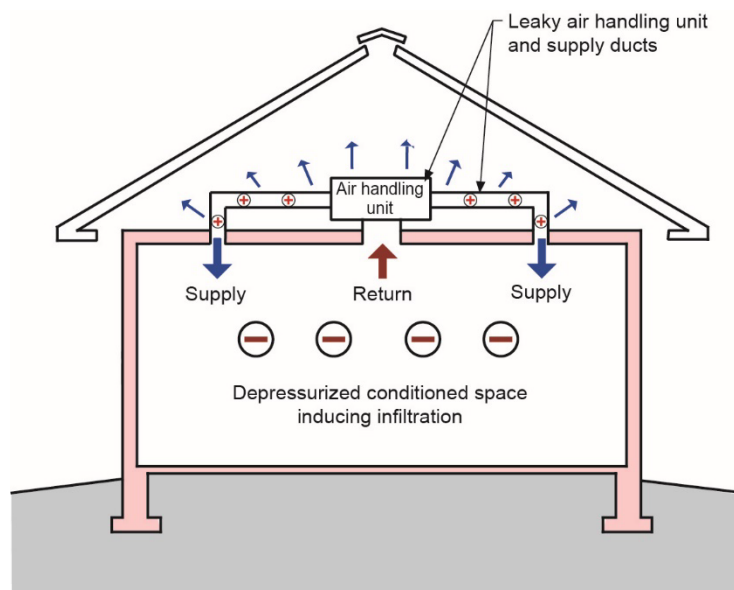


Figure 1. (Lstiburek, J.W.)

- **Fire Protection.** Unvented attics can provide other benefits as well including helping to reduce the spread of fires. This is particularly true for areas where buildings are close to one another, typically fires start in neighboring buildings due to debris getting sucked into the house via attics vents, if there are no vents it can significantly reduce the fire risk.
- **Wind Uplift.** Other benefits come in areas of the country where there is a high wind potential, mostly the coastal areas. High wind events can cause the soffit vents to breakdown and create significant uplift on the roof assemblies which can cause damage to the roof assembly and rest of the dwelling.
- **Moisture Control in Humid Climates.** The traditional way of thinking is that vented attics help to alleviate moisture issues and this may be true in certain climate zones. In a hot humid climate having a vented attic will cause moisture problems, it will bring the hot humid air from outside the home into the attic which causes ductwork to sweat which in turn can cause moisture and mold growth on sheathing and framing. The alternative is unvented attics, these attics have shown to have some moisture concerns as well near the ridge, however, the introduction of vapor diffusion ports has shown to significantly reduce the moisture build up in these area to help to alleviate moisture build up. The difference in moisture is shown below.

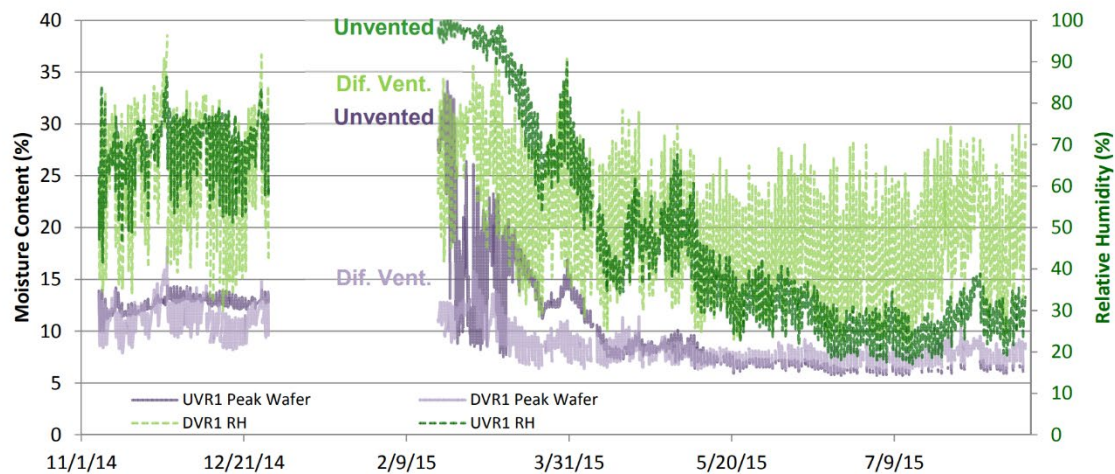


Figure 2. (Ueno, K and Lstiburek, J.W)

- **Cost Effectiveness.** *Description on how using air-permeable insulation to construct a home with a conditioned attic is a low cost pathway for builders*

References:

1. Lstiburek, J.W.; Venting vapor, ASHRAE Journal, July 2015.
2. Ueno, K and Lstiburek, J.W.; Building America Report: Field testing of an unvented roof with fibrous insulation, tiles, and vapor diffusion venting, Building Science Corporation, November 2015.

Regards,

**Shawn Mullins**

Sr. Sales Lead: Technical Sales & Government Affairs

North American Building Insulation | Sales

M: 623-695-5694

[shawn.mullins@owenscorning.com](mailto:shawn.mullins@owenscorning.com)